


Wymiary otworu w stropie

Wymiar otworu w stropie

Otwór na drzwi z ościeżnicą		
Przystanek	Szerokość	Wysokość
A 1	1400	2250
A 2	1400	2250
A 3	1400	2250
C 0	1400	2250

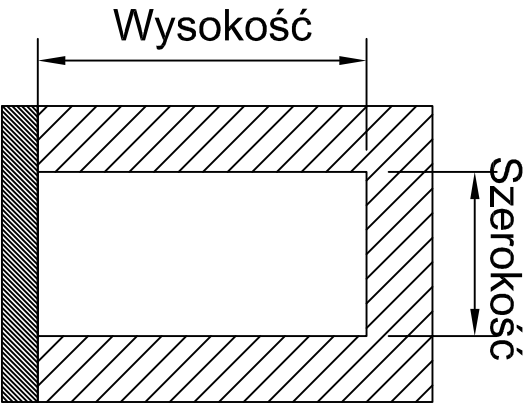

Otwór na drzwi

Incoming power supply is connected at landing:

For wiring and power supply, refer to the unit's wiring diagrams.

Ceiling shaft lighting is independent from the power cable and pulled back into the trench's upper part. Shaft lighting > 50 lux.

NOTE! An effective emergency telephone is required for approved inspection.


The purchaser is responsible for an active phone line being present prior to the lift installation.

The incoming telephone line is connected to C1ow (TELE). Refer to wiring diagram.



The emergency signal device is powered by the lift's own battery in the event of a power failure.

The lift must be equipped with a two-way communication, either via the standard telephone or via the lift telephone, which automatically calls the alarm control center or the like.


NOTE! A lift featuring a frequency converter cannot be directly connected to a RCD.

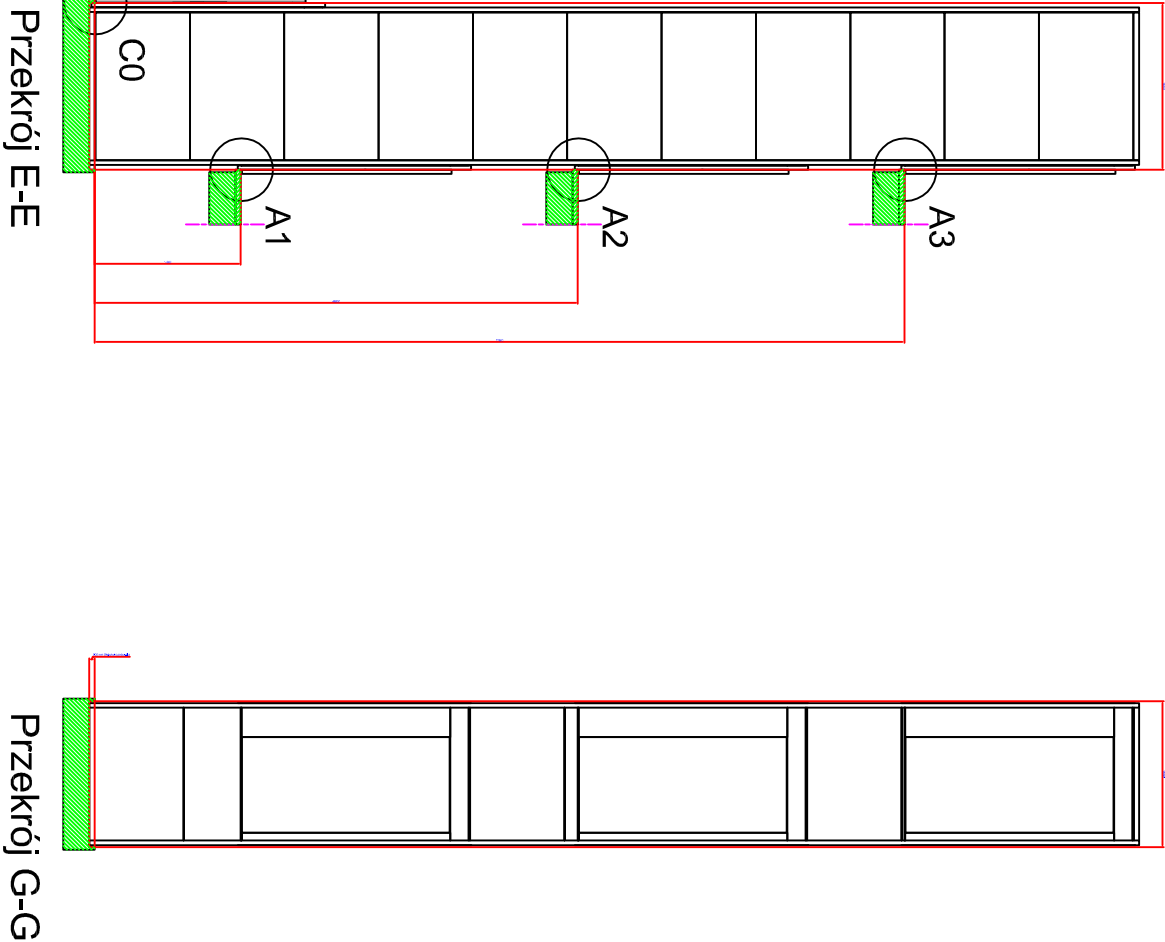

50 mm podszycie, powinno być płaskie, tolerancja +10 mm, - 0mm

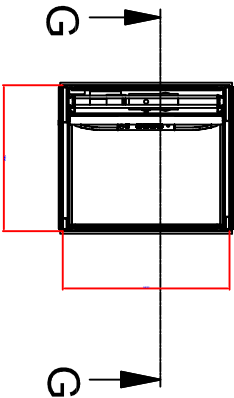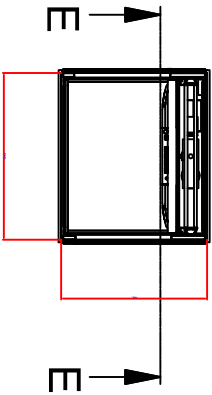

C0 (1:5)

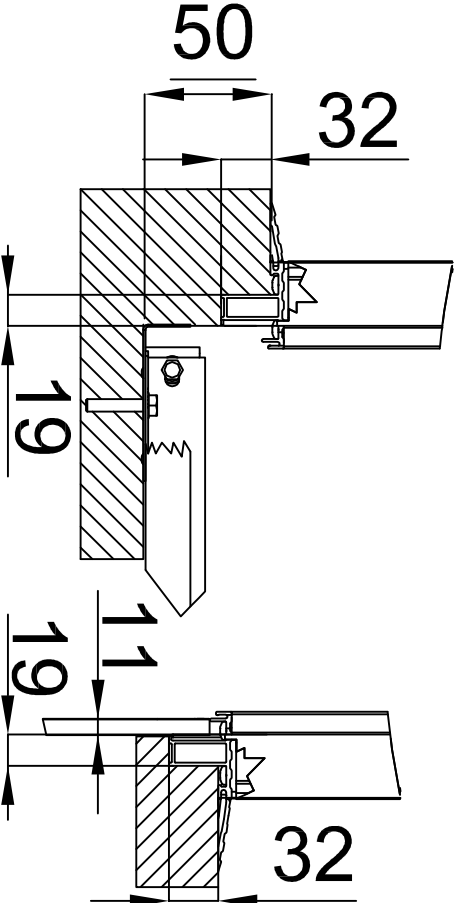

A1,2,3 (1:5)

Incoming power supply is connected at landing:
For wiring and power supply, refer to the unit's wiring diagrams.
Ceiling shaft lighting is independent from the power cable and pulled back into the trench's upper part. Shaft lighting > 50 lux.
NOTE! An effective emergency telephone is required for approved inspection.
The purchaser is responsible for an active phone line being present prior to the lift installation.
The incoming telephone line is connected to C1ow (TELE). Refer to wiring diagram.
The emergency signal device is powered by the lift's own battery in the event of a power failure.
The lift must be equipped with a two-way communication, either via the standard telephone or via the lift telephone, which automatically calls the alarm control center or the like.
NOTE! A lift featuring a frequency converter cannot be directly connected to a RCD.

ebe STUDIO Pracownia Architektoniczna			
Płac Moniuszki 2b, 25-334 Kielce, www.ebestudio.pl, mail: ebe.studio@gmail.com, tel. 503 163 865			
OBIĘKT:	Nadbudowa łącznika pomiędzy bud. szkoły a bud. internatu z przeznaczeniem całości na potrzeby Zespołu Szkół Informatycznych, budowie drogi pozarowej, parkingu dla sam. osobowych do 48 miejsc, na działce nr ewid. 99 obręb 0011, ul. Warszawska 96 w Kielcach		
STADIUM:	Projekt budowlano-wykonawczy		
TREŚĆ:	Podnośnik zewnętrzny - wymiary otworów		
PROJEKTANT:	mgr inż. arch. Edyta Banachowska	nr uprawnień: Sw-5/2003	podpis:
	mgr inż. arch. Beata Mazurek	nr uprawnień: K1-42/2000	podpis:
			1:100, 1:5
			06.2018

